


**COMMISSIONERATE OF HYDERABAD DISASTER RESPONSE AND
ASSET PROTECTION AGENCY (HYDRAA)**

From
The Commissioner,
Hyderabad Disaster Response
And Asset Protection Agency,
(HYDRAA).

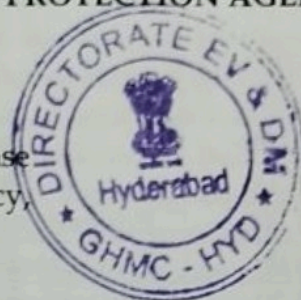

To
The Management,
"Euro School"
Sy.No.54, Gachibowli (V),
Serilingampally (M),
Ranga Reddy District.

Rc. No. e - 761081/2024, Dated: 13.09.2024.

Sub : - Commissionerate - HYDRAA - Existing Non High Rise Building of "Euro School" consisting of Sub Cellar + Cellar + Ground + 4 Upper Floors situated at Sy.No.54, Gachibowli (V), Serilingampally (M), Ranga Reddy District - **Fire No Objection Certificate - Issued** - Regarding.

- Ref : -
- 1) Proceeding Rc. No. 5041/B2/97, Dated: 12.03.2010 of the Director General of the State Disaster Response and Fire Services, A.P., Hyd.
 - 2) Proceedings No. DM/0011/2018/D(VK) EVDM/2018, dt. 29.06.2018 of the Commissioner, GHMC
 - 3) G.O.MS.No. 99 of MA&UD (GHMC. I) Dept, Dated 19-07-2024.
 - 4) Application of the management of Euro School, received vide E-office receipt No.761081/C3/2024/EV&DM Dated: 09.08.2024.
 - 5) **Inspection report dated: 13.09.2024.**

1. Vide reference 5th cited, the team has inspected the Existing Non High Rise Building of "Euro School" consisting of Sub Cellar + Cellar + Ground + 4 Upper Floors situated at Sy.No.54, Gachibowli (V), Serilingampally (M), Ranga Reddy District and submitted the following report.

2. Particulars of the Building:

a)	Name & Address of the building	"Euro School" Sy.No.54, Gachibowli (V), Serilingampally (M), Ranga Reddy District.
b)	Plot Area/Height	2124.53 Sq. Meters/14.90 Meters
c)	No of floors	Sub Cellar + Cellar+ Ground + 4 Upper Floors
d)	Name of the Owner& Mobile no.	The Management, "Euro School" 9963999977
e)	Occupancy Certificate No. & Date	14626/01/03/2012/OC, Dated: 10.09.2013
f)	Map Location	17.433161° 78.373615°

3. Floor wise details:

Sl. No.	Floor	Area in Sq. Meters	Type of Occupancy	Max Occupant Load
1	Sub-Cellar	1320.00	Parking	-
2	Cellar	1161.00	Parking	-
3	Ground Floor	821.00	Educational (B-1, School)	205
4	First Floor	945.00	Educational (B-1, School)	236
5	Second Floor	945.00	Educational (B-1, School)	236
6	Third Floor	945.00	Educational (B-1, School)	236
7	Fourth Floor	945.00	Educational (B-1, School)	236
Total		7082.00	-	-

4. Open Spaces All Round Building:

Sl. No.	Directions	Required as per Occupancy Certificate	Provided	Deficit
1	Front	9.21 Meters	9.21 Meters	Nil
2	Side I	5.00 to 5.20 Meters	5.00 to 5.20 Meters	Nil
3	Side II	5.00 Meters	5.00 Meters	Nil
4	Rear	5.25 to 5.65 Meters	5.25 to 5.65 Meters	Nil

5. Means of escape:

Sl. No.	Required as per N.B.C - 2005			Provided		Remarks
	Staircases	Nos.	Width	Nos.	Width	
1	Internal / External	02	1 X1.50 Meters 1 X1.25 Meters	02	1X1.55 Meters 1X0.90 Meters (MS)	The aggregate staircase width of 2.45 meters, meets the required exit staircase width based on occupant load.
Total			2.75 Meters		2.45 Meters	


6. The Fire Safety Installations required & provided as per Table 7, Part-4 of N.B.C of India 2016:

Sl. No.	Fire Safety Installations	Required	Provided	Deficit
1	Fire Extinguishers	75 Nos.	75 Nos.	Nil
2	First Aid Hose Reel	07 Nos.	07 Nos.	Nil
3	Down Comer	NR	01 No.	Nil
4	Automatic Sprinklers in cellars	114 Nos.	114 Nos.	Nil
5	Manually operated Fire alarm system	NR	07 Nos.	Nil
6	Terrace Tank	15,000 Liters	25,000 Liters	Nil
7	Pump at the Terrace Tank Level	1 No. Booster Pump of 900 LPM	1 No. Booster Pump of 900 LPM	Nil

Terms & Conditions: -

1. The Fire NOC issued is confined to the Fire Safety measures installed in the building and does not confer any Legal right for claiming of Ownership of property or Conversion of land use / Occupancy or Building Regularization. The Owner / Occupier shall comply the Building Rules / Govt. Orders as applicable.
2. Fixed and first-aid Fire Fighting equipment, alarm etc., shall be tested and maintained regularly as per applicable standards and Fire-Drills shall be conducted quarterly for first two years and half yearly after two Years.
3. Emergency power generator etc., and associated equipment should be tested periodically, verified as per NBC, and IS-1646.
4. Adequate ventilation should be provided in all floors of the building.
5. Every room with a capacity of 45 students shall be provided minimum two doorways.
6. Evacuation plan showing exit routes and recommended action plan shall be displayed at conspicuous locations. All escape/exit routes shall not be blocked or encroached.
7. Fresh NOC would be required for any change in occupancy or additions/alterations in the building structure as per NBC of India and building bye/laws.
8. The Management has to maintain Fire Safety Installations at all times in good working Condition as seen during the inspection.
9. Any Loss of life or property due to Non - functioning of Fire Safety Systems and other installations will be the responsibility of the management/owner.
10. All the Occupants must know the correct method of operation of the Fire Fighting Systems installed in the building.
11. All Security personnel shall be trained to operate the available fire-fighting equipment.
12. This Fire No Objection Certificate is valid for one (01) year from the date of issue and shall be renewed every year. It is the responsibility of the owner/occupier to apply for renewal before two months of its expiry.

In view of the above, the **Fire No Objection Certificate** is issued to Existing Non High Rise Building of "Euro School" consisting of Sub Cellar + Cellar + Ground + 4 Upper Floors situated at Sy.No.54, Gachibowli (V), Serilingampally (M), Ranga Reddy District.


Commissioner,
Hyderabad Disaster Response
And Asset Protection Agency
(HYDRAA).